


MATCH LINE PAGE 2 DETAIL C

DETAIL 'D'

CONSTRUCTION PROCEDURE FOR DETAIL 'C' & 'D'		
NOTE 1: PRESSURE GAUGES MUST BE INSTALLED & CONTINUOUSLY MONITORED AT ALL VALVING, STOPPERING, AND SQUEEZE OFF LOCATIONS.		
SCOPE OF WORK	DATE	NAME
1. INSTALL APPROXIMATELY 2,516' OF 4" PLS, 25 PSIG MAIN AND 325' OF 2" PLS, 25 PSIG MAIN.		
2. PRESSURE TEST NEW 25 PSIG MAINS AT A MINIMUM OF 100 PSIG, PER MEC STANDARDS.		
3. COMPLETE TIE-IN 'H' & 'I' AND PURGE NEW 25 PSIG MAIN PER MEC STANDARDS. SEE PAGE 2.		
4. COMPLETE TIE-IN 'L' AND PURGE NEW 25 PSIG MAIN PER MEC STANDARDS. SEE PAGE 1.		
5. INSTALL BY-PASS FOR TIE-IN 'S' AS SHOWN ON PAGE 1.		
6. COMPLETE TIE-IN 'M' AND CUT & CAP #8. SEE PAGE 1.		
4. REPLACE AND TEST & RECONNECT SERVICES PER ATTACHED SERVICE LIST.		
4. COMPLETE TIE-INS 'J', 'K', 'N', 'O', 'P', 'Q', 'R' AND 'S' AND CUT & CAPS #7, #9, #10, #11, #12, #13 & #14.		

NOTES

- PRESSURE GAUGES MUST BE INSTALLED & CONTINUOUSLY MONITORED AT ALL SQUEEZE OFF, VALVING & STOPPERING LOCATIONS.
- ALL WORK, INCLUDING PRESSURE TESTING AND PURGING TO BE COMPLETED ACCORDING TO MEC GAS STANDARDS.

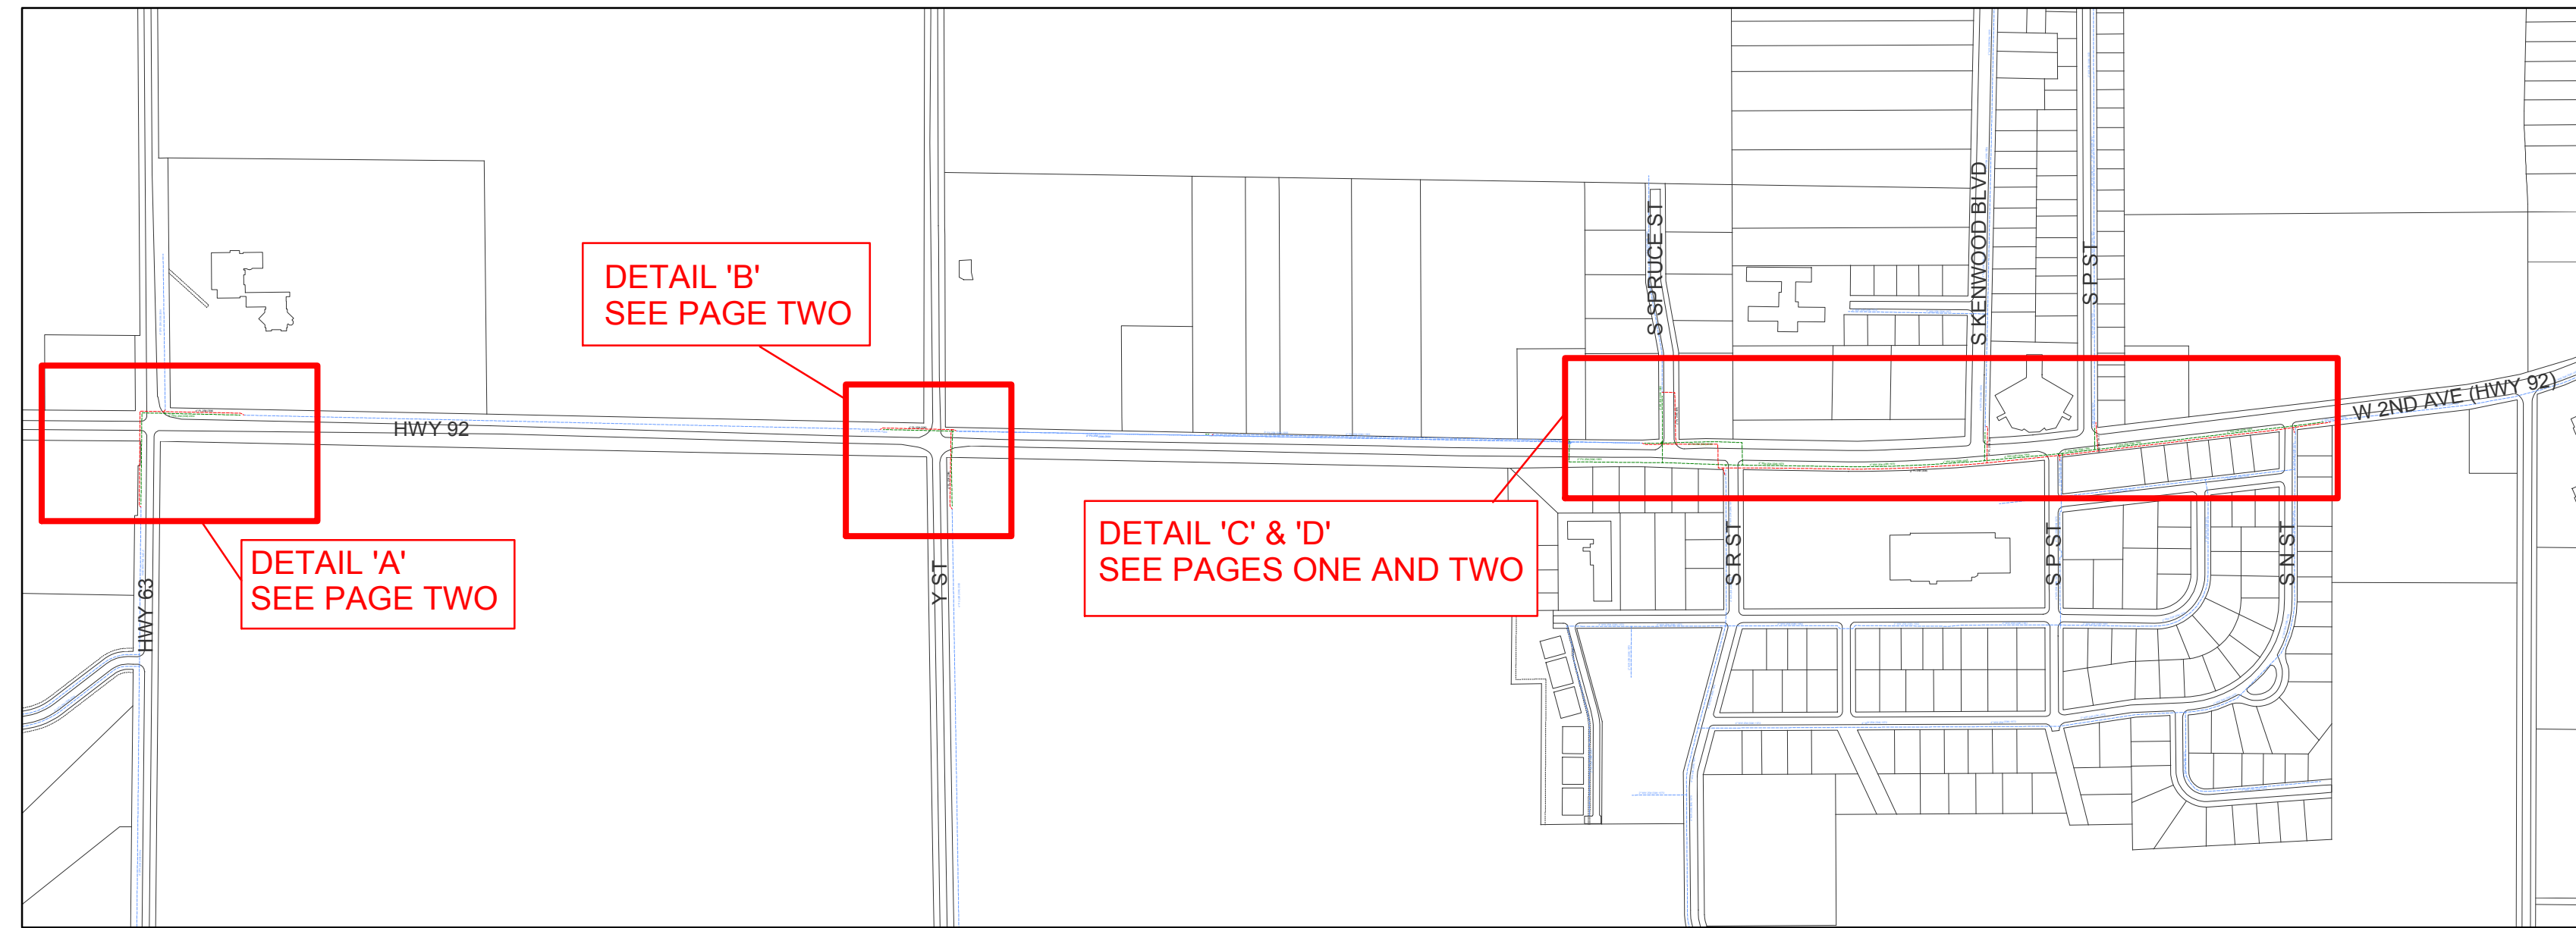

VICINITY MAP

LEGEND	
EXISTING 25 PSIG SYSTEM	
PROPOSED 25 PSIG MAIN	
PROPOSED RETIRED 25 PSIG MAIN	

SERVICE LIST FOR HWY 92 REBUILD				
ADDRESS	EXISTING SERVICE	PROPOSED SERVICE	PROPOSED METER	REGULATOR
W 2ND AVE				
2305	1" Plastic	1" Plastic	AC-250	371-372102
2205	1" Plastic	1" Plastic	AC-250	371-372102
2011	1/2" Plastic	1" Plastic	AC-250	371-372102
1905	1" Plastic	Test & Reconnect	Reuse Existing	Existing
1901	1/2" Plastic	Test & Reconnect	Reuse Existing	Existing
1900	Unknown	1" Plastic	AC-630	371-382111
1806	3/4 Steel	1" Plastic	AC-630	371-382112
1522	1" Steel	1" Plastic	AL-425	371-382112

LIST TO BE USED AS A GUIDE ONLY - CONTRACTOR RESPONSIBLE FOR LOCATING SERVICES